



July 23, 2019

**ADDENDUM NO. 002 TO SPECIFICATION NO. 1361W**  
**Mountain Ave West Replenishment Basin**

**QUESTIONS & ANSWERS**

**Northwest Pipe Company**

- Q1. Please clarify what paint system is required for the above ground Raw Water Inlet 1 and 2 piping
- A1. The coating for the exterior pipe should be per the EMWD standard specification, Specification 9900, Section 2.04 Service Condition B *"Ferrous metals, other than stainless steel, not subject to chemical attack, normal indoor or outdoor exposure, shall be prepared and coated in accordance with the following requirements."* The color shall be desert tan.

**Pacific Hydrotech Corp**

- Q1. Is over excavation of slopes required as noted in the soils report? This is not shown on the drawings.
- A1. Pursuant with the project geotechnical report, all slopes shall be scarified a minimum of 6-inches and over excavated as required to obtain 90% relative compaction prior to the placement of soil cement.
- Q2. Is there any charges for construction water?
- A2. The Contractor can obtain water, free of charge, upon proper arrangements for metering its use from the Districts Resident Inspector in accordance with SC-07.
- Q3. Soil cement is shown on the drawings section A on C-5 as having 3' horizontal at top & bottom. But is not reflected on the plan sheets C-3, C-4, & C-5. Is the survey coordinates at top of slope or edge of soil cement?
- A3. Survey control information is to the top of the slope.



Q4. Can we get a better detail at the gate openings including size of gate location of man gates etc.?

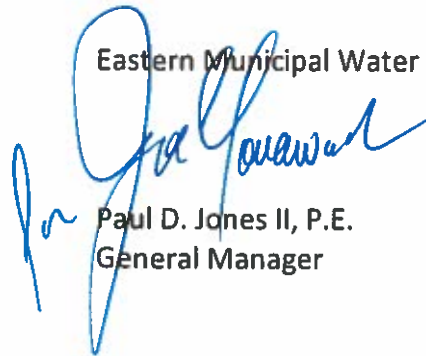
A4. Gate details and openings are shown on the contract drawings on sheet C-8. Gate opening widths shall be per plan (30-feet at driveway, 4-feet for man gates).

**B&K Valves & Equipment, Inc.**

Q1. Is it your intention to require submittals for review and approval by the district 10 days prior to bid date for Butterfly Valves that are already on EMWD's Approved Materials List, but are not specifically called out in Section 15103?

A1. Products listed in the Approved Materials List do not require review and approval prior to the bid opening.

for  
PE:   
PM:   
DFE: B&K  
DE:     

Eastern Municipal Water District  
  
Paul D. Jones II, P.E.  
General Manager

PDJ:GK:BAM:ae