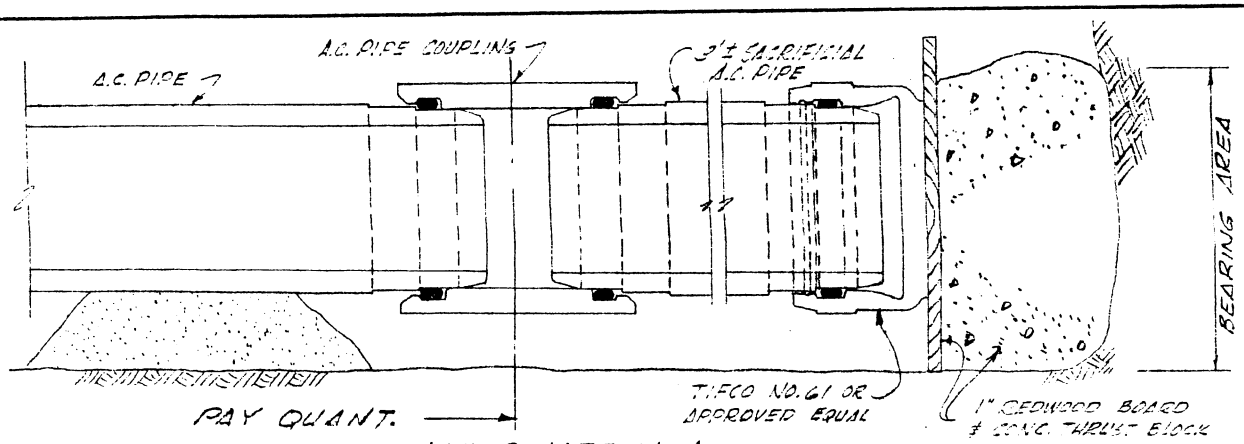

ALTERNATE No. 1

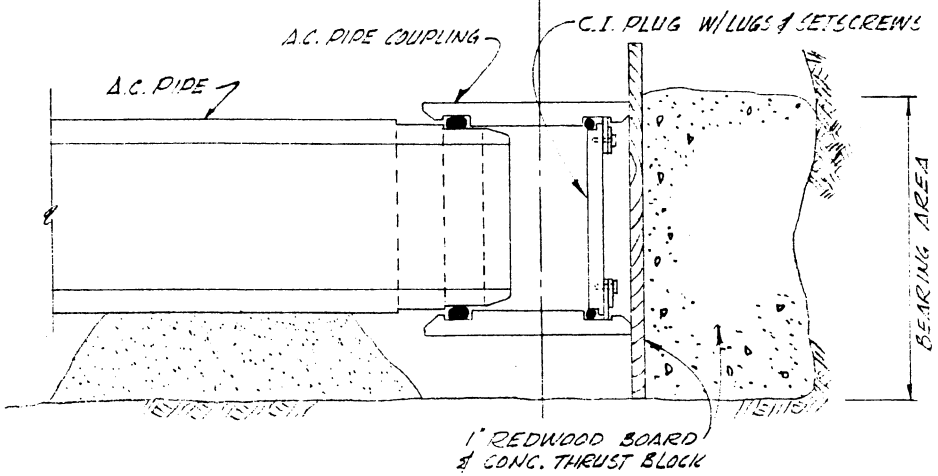

ALTERNATE No. 2

NOTES:

1. Concrete thrust blocks to be poured against undisturbed earth with minimum bearing area in accordance with B-407 (TEE).
2. Concrete thrust blocks shall be of class "C" (2000 P.S.I.) concrete.

REVISIONS				
NO.	DATE	INITIAL	DESCRIPTION	APP'VD
1	3/85	GH.	REFERRED TO B-407	[illegible]

REFERENCES		
DWGS. B-407 & B-408		

APPROVALS		
LM 1-4-66	[illegible]	CAG 1-4-66
DESIGN	CONSTRUCTION	OPERATIONS

		DATE
SCALE	NONE	
DESIGNED	LM	12-13-65
DRAWN	RWH	12-14-65
TRACED		
CHECKED	LM	
SUBMITTED	[illegible]	
RECOMMENDED	[illegible]	

EASTERN MUNICIPAL WATER DISTRICT
RIVERSIDE COUNTY, CALIFORNIA

STANDARD DRAWING
WATER PIPELINE END PLUG INSTALLATION FOR A.C. PIPE

APPROVED [illegible] GENERAL MANAGER & CHIEF ENGINEER

B-414