


GENERAL NOTES

1. PAINTS: HYDRANTS TO BE PAINTED WITH APPROVED YELLOW.
2. USE THRUST BLOCKS PER B-407 FOR ACP. USE RESTRAINED JOINTS PER B-863 FOR PVC AND DUCTILE IRON. CONCRETE FOR THRUST BLOCKS AND SUPPORTS TO BE CLASS "C" (2000 PSI) CONCRETE.
3. ALTERNATE MATERIALS MAY BE USED WHEN SPECIFIED.
4. FIELD COATING FOR EXPOSED PIPE SHALL BE PER EMWD SPECIFICATIONS AND APPROVED MATERIALS.
5. LENGTH OF BREAK-OFF RISER TO BE DETERMINED BY THE DIFFERENCE IN ELEVATION BETWEEN THE CENTER GRADE OF THE PIPELINE OUTLET AND THE TOP OF THE CURB OR PROPOSED GRADE, LESS THE LENGTH FOR THE FIRE HYDRANT BURY. IF BREAK-OFF RISER EXCEEDS 18", USE NEXT 1 FT LONGER BURY.
6. BLOW-OFF LOCATION: TEMPORARY BLOW-OFFS SHALL BE LOCATED SO THEY DO NOT INTERFERE WITH FUTURE IMPROVEMENTS THAT WILL BE INSTALLED PRIOR TO THE WATER MAIN EXTENSION.
7. WHEN NO CURBS OR SIDEWALKS ARE PROPOSED BLOW-OFF IS TO BE PLACED 18" WITHIN THE ROAD RIGHT-OF-WAY.



REVISIONS				APPROVALS			
NO.	DATE	INITIAL	DESCRIPTION	APP'D	DATE	INITIAL	DATE
△	4/19/93		REDRAWN W/CADD ON MYLAR	VJB	5/19/93		
△	4/17/00	GR	REV ALL FONT, NOTE 2 & ADDED NOTE 7	VJB	5/19/00		
△	10/28/03	CM	REV. NOTES FOR AC PIPE & VALVE LOCATION	VJB	10/28/03		
△	2/23/11	GS	REVISED TRACT BOUNDARY NOTE	SMM	02/28/11		

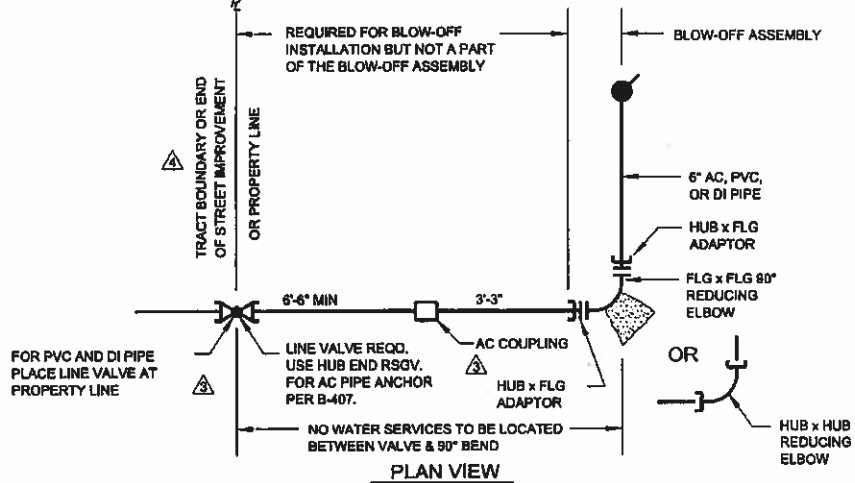

EASTERN MUNICIPAL WATER DISTRICT
STANDARD DRAWING

6" x 1-2 1/2" BLOW-OFF TEMPORARY END
INSTALLATION - AC, PVC, DI PIPE

REFERENCES: ORIG DRAWN BY JMA 11/77 SCALE: NONE
 FILE I.D.s: kuaufengstd dwgs/b568.dgn DRAWN BY GS RECOMMENDED Joseph D. Van Sickle 6/1/93
 DIRECTOR OF ENGINEERING DATE APPROVED G. Hooits Ruggs 7/2/93
 CHIEF ENGINEER DATE B-568