



LINE CURRENT TEST STATION
NOT TO SCALE

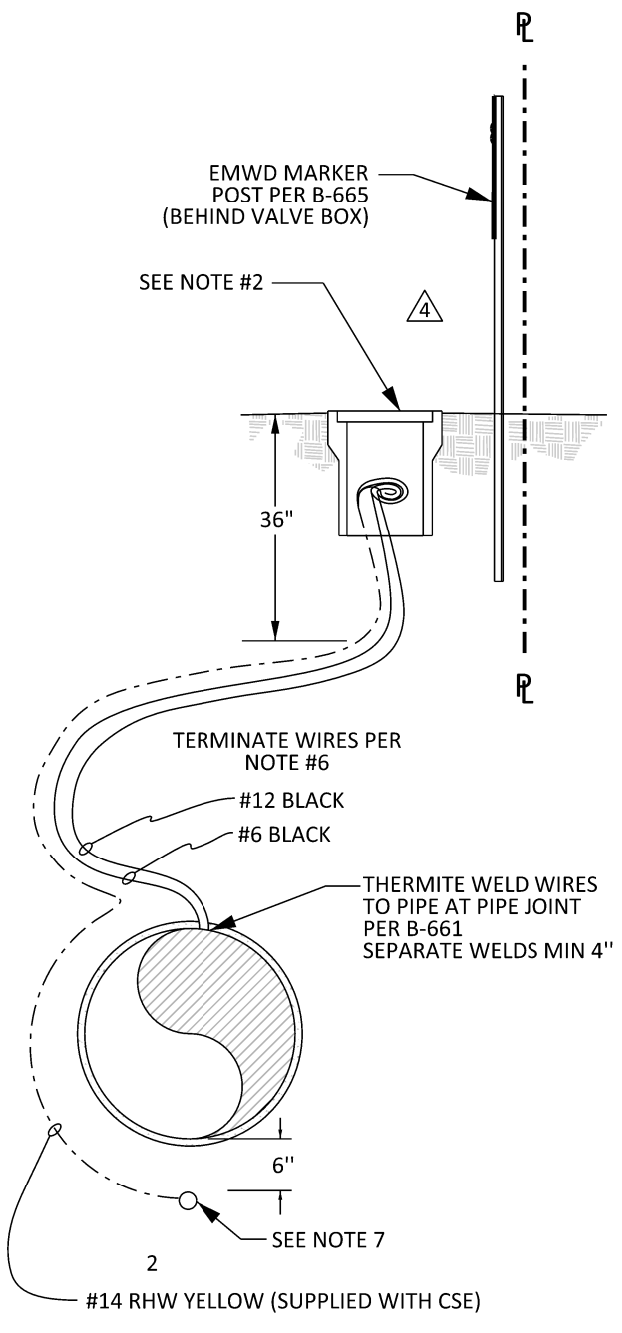

BASIC TEST STATION
NOT TO SCALE

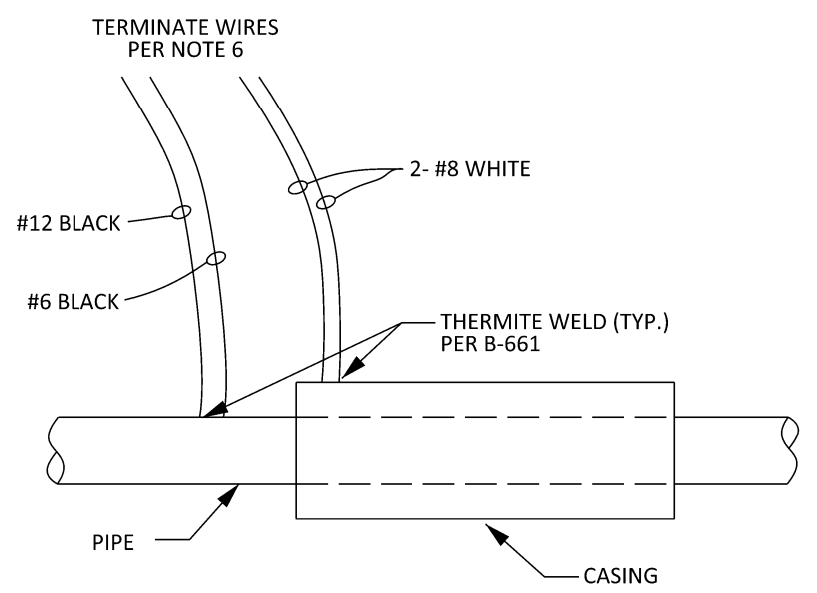

PIPE W/CASING TEST STATION
NOT TO SCALE

NOTES:

1. LEAD WIRES SHALL BE 36" DEEP THROUGH ROAD SHOULDER AND 24" OTHERWISE.
2. THE VALVE BOX SHALL BE LOCATED JUST OUTSIDE THE PROPERTY LINE (IN STREET R/W) EXCEPT AS OTHERWISE DIRECTED BY THE ENGINEER.
3. WHITE WIRES SHALL ALWAYS BE PLACED BELOW AND ON THE NORTH AND EAST SIDE OF THE TEST STATION.
4. PIPELINE SHALL BE ASSEMBLED IN TRENCH PRIOR TO THERMITE WELDING.
5. WIRE AND BONDED CONNECTIONS SHALL BE PROTECTED DURING FIELD MORTARING OF PIPE JOINTS.
6. TERMINATE ALL WIRES A MINIMUM OF 1 FT ABOVE GROUND LEVEL AND COIL EXCESS WIRE IN BOX.
7. COPPER-COPPER SULFATE ELECTRODE (CSE) INSTALLED ONLY WHEN SPECIFIED ON PLANS.
8. FOR WIRES ABOVE GROUND, TAG INDIVIDUAL WIRES FOR IDENTIFICATION PURPOSES, FOR BURIED WIRES, PLACE MARKER TAPE.

REVISIONS						APPROVALS		
NO.	DATE	INITIAL	DESCRIPTION	APP'D	DATE	DESIGN	INITIAL	DATE
4	5/6/19	GS	UPDATED TITLE BLOCK, FONT, MARKER POST DETAIL AND LOGO	AGA	5/6/19	CONSTRUCTION		
3	10/29/07	RE	ADDED NOTE #8	JM	12/18/07	INSPECTION	JEW	4/23/97
2	5/4/99	GR	REVISED #14 RHW COLOR	VJB	5/6/99	OPERATIONS	LMc	1/28/97
1	5/4/99	GR	SUPERCEDES B-582	VJB	5/6/99	SUBMITTED		

**EASTERN MUNICIPAL WATER DISTRICT
STANDARD DRAWING**

**TEST STATION: LINE CURRENT, BASIC
AND PIPE WITH CASING**

REFERENCES: B-661 SUPERCEDES B-582	SCALE: NONE
FILE I.D.: \kauai\eng\std dwgs\B-662.dgn	DRAWN BY: KER

RECOMMENDED Michael G. Meyerpeter 1/24/97
DIRECTOR OF ENGINEERING DATE

APPROVED Charles J. Bachmann 4/25/97
ASSISTANT GENERAL MANAGER DATE

B-662

