


NOTES:

- DOUBLE CHECK BACKFLOW PREVENTER ASSEMBLIES MAY ONLY BE INSTALLED FOR LOW HAZARD (NON-CHEMICAL) AREAS AND MUST BE APPROVED BY BOTH EMWD INSPECTION AND CROSS CONNECTION STAFF.
- PROVIDE AN USC APPROVED BACKFLOW PREVENTION ASSEMBLY AS DESIGNATED BY EMWD APPROVED MATERIALS LIST SPECIFICATIONS.
- EMWD MAINTENANCE RESPONSIBILITY STOPS AT THE METER. THE CUSTOMER IS RESPONSIBLE TO TEST AND MAINTAIN THE BACKFLOW PREVENTION ASSEMBLY, IN ACCORDANCE WITH EMWD ORD. 69.
- ONLY RIVERSIDE COUNTY CERTIFIED BACKFLOW TESTERS LISTED ON THE EMWD APPROVED BACKFLOW TESTER LIST ARE ALLOWED TO TEST OR MAINTAIN BACKFLOW ASSEMBLIES WITHIN EMWD SERVICE AREA.
- BACKFLOW CERTIFICATION TESTING IS REQUIRED ANNUALLY AT A MINIMUM BUT MAY BE MORE FREQUENT AS DEEMED NECESSARY BY EMWD. CERTIFICATION TESTING IS REQUIRED IMMEDIATELY AFTER AN ASSEMBLY IS RELOCATED, REPLACED, REPAIRED, NEW INSTALLATION ACCEPTANCE AND WATER DELIVERY PER EMWD ORD. 69 PRIOR TO NEW INSTALLATION ACCEPTANCE AND WATER DELIVERY.
- BACKFLOW PREVENTION ASSEMBLY SIZE SHALL MATCH THE DIAMETER OF THE METER IN ACCORDANCE WITH THE UNIFORM PLUMBING CODE; CHAPTER 6, SECTION 610 AS AMENDED, OR UP TO 1" INCH LARGER.
- BACKFLOW PREVENTION ASSEMBLY INSTALLATIONS INCLUDING ALL APPURTENACES FOR THE SUPPLY OF DOMESTIC WATER SHALL COMPLY WITH THE REQUIREMENTS OF THE CALIFORNIA LEAD-FREE ACT AB1953.
- BACKFLOW PREVENTION ASSEMBLIES SHALL BE LOCATED AS CLOSE AS PRACTICAL TO THE WATER METER BOX BUT NOT FURTHER THAN 3 FEET UNLESS A VARIANCE IS OBTAINED FROM AN EMWD CROSS-CONNECTION SPECIALIST PRIOR TO INSTALLATION.
- NO OUTLETS, TEES, OR CONNECTIONS SHALL BE ALLOWED BETWEEN THE METER AND THE BACKFLOW PREVENTION ASSEMBLY.
- BACKFLOW PREVENTION ASSEMBLIES SHALL MAINTAIN A VERTICAL CLEARANCE FROM THE LOWEST POINT OF 12 INCHES (MINIMUM) TO 36 INCHES (MAXIMUM) ABOVE FINISHED GRADE, WITH SIDE AND TOP CLEARANCES OF 12 INCHES (MINIMUM) FROM ANY OBSTRUCTIONS IN ALL DIRECTIONS.
- POLYETHYLENE ENCASMENT SHALL BE INSTALLED PER ANSI/AWWA C105/A21.5 REQUIREMENTS. HIGH-DENSITY POLYETHYLENE (HDCLPE) SHALL BE A MINIMUM OF .004 (4 MIL) THICKNESS. LOW-DENSITY POLYETHYLENE (LLDPE) SHALL BE A MINIMUM OF .008 (8 MIL) THICKNESS.

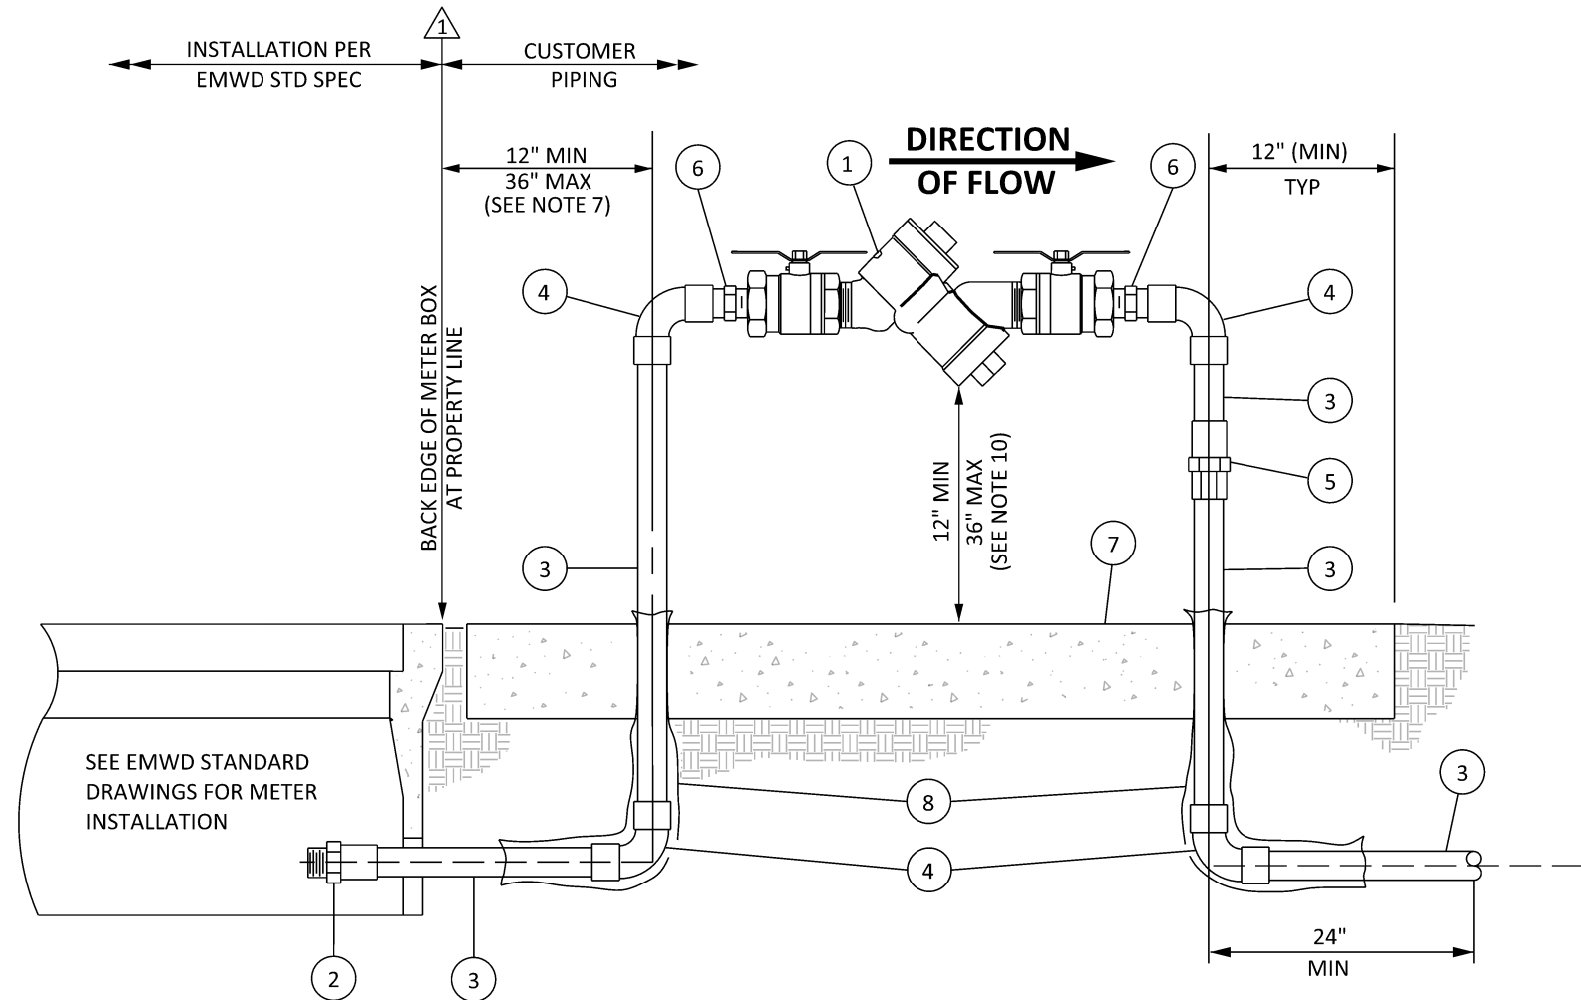

RECOMMENDATIONS:

- PARALLEL INSTALLATIONS OF THE SAME TYPE OF BACKFLOW PREVENTION ASSEMBLIES ARE STRONGLY RECOMMENDED FOR ALL FACILITIES REQUIRING UNINTERRUPTED WATER SUPPLY.
- FREEZE PROTECTION IS RECOMMENDED. TESTCOCK OPENINGS SHALL BE LEFT EXPOSED.
- THEFT PREVENTION DEVICES ARE STRONGLY RECOMMENDED FOR BRONZE ASSEMBLIES ALLOWING ADEQUATE ACCESS TO THE ASSEMBLY FOR TESTING AND MAINTENANCE.

TABLE "A"

METER SIZE	BACKFLOW SIZE
3/8" MULTIJET (15 GPM)	3/4"
3/4" MULTIJET (20 GPM)	3/4"
1" MULTIJET (30 GPM)	1"
1 1/2" MULTIJET (75 GPM)	1 1/2"
2" MULTIJET (120 GPM)	2"

ITEM	DESCRIPTION
1	3/4" THRU 2" DOUBLE CHECK BACKFLOW PREVENTER WITH VALVES
2	COPPER ADAPTER, COPPER SOLDER JOINT x MALE IPT
3	COPPER WATER TUBE, TYPE L HARD OR BRASS
4	COPPER 90° ELBOW WITH COPPER SOLDER JOINTS
5	COPPER UNION WITH COPPER SOLDER JOINTS
6	COPPER ADAPTER, MALE SOLDER x MALE IPT
7	18" WIDE x 4" THICK CONCRETE PAD, LENGTH VARIES PER SIZE
8	POLYETHYLENE ENCASMENT (SEE NOTE 11)

REVISIONS				APPROVALS			EASTERN MUNICIPAL WATER DISTRICT		EASTERN MUNICIPAL WATER DISTRICT STANDARD DRAWING	
NO.	DATE	INITIAL	DESCRIPTION	APP'D	DATE	DESIGN			INITIAL	DATE
						CONSTRUCTION	ML	11/14/11	RECOMMENDED <u>Joe Mouawad</u> 11/29/11 DIRECTOR OF ENGINEERING DATE	
						INSPECTION	JEW	11/15/11		
						OPERATIONS	KG	11/14/11		
						SUBMITTED	YJB	11/14/11		
	9/15/20	GS	UPDATE TITLE BLOCK, FONT, LOGO, DELINEATION CALLOUT, ADDED METER TABLE "A"	AGA	9/15/20					APPROVED <u>Charlie J. Bachmann</u> 11/30/11 ASSISTANT GENERAL MANAGER DATE
REFERENCES:				SCALE: NONE						B-966
FILE I.D.: \kawaii\eng\std dwgs\B-966.dgn				DRAWN BY: SL						