


NOTES:

1. ALL MATERIALS SHALL CONFORM TO THE UNIFORM PLUMBING CODE AND AWWA STANDARDS.
2. THIS ASSEMBLY IS MEANT TO KEEP THE BUILDING SUPPLIED WITH POTABLE WATER DURING CROSS CONNECTION SHUT DOWN TESTING.
3. SIZING OF THE CROSS CONNECTION BYPASS ASSEMBLY WILL BE DETERMINED BY THE CIVIL ENGINEER.
4. EMWD RECOMMENDS SECURING THE ASSEMBLY WITHIN A LOCKABLE ENCLOSURE.
5. ALL VALVE OUTLETS SHALL BE CAPPED WHEN NOT IN USE

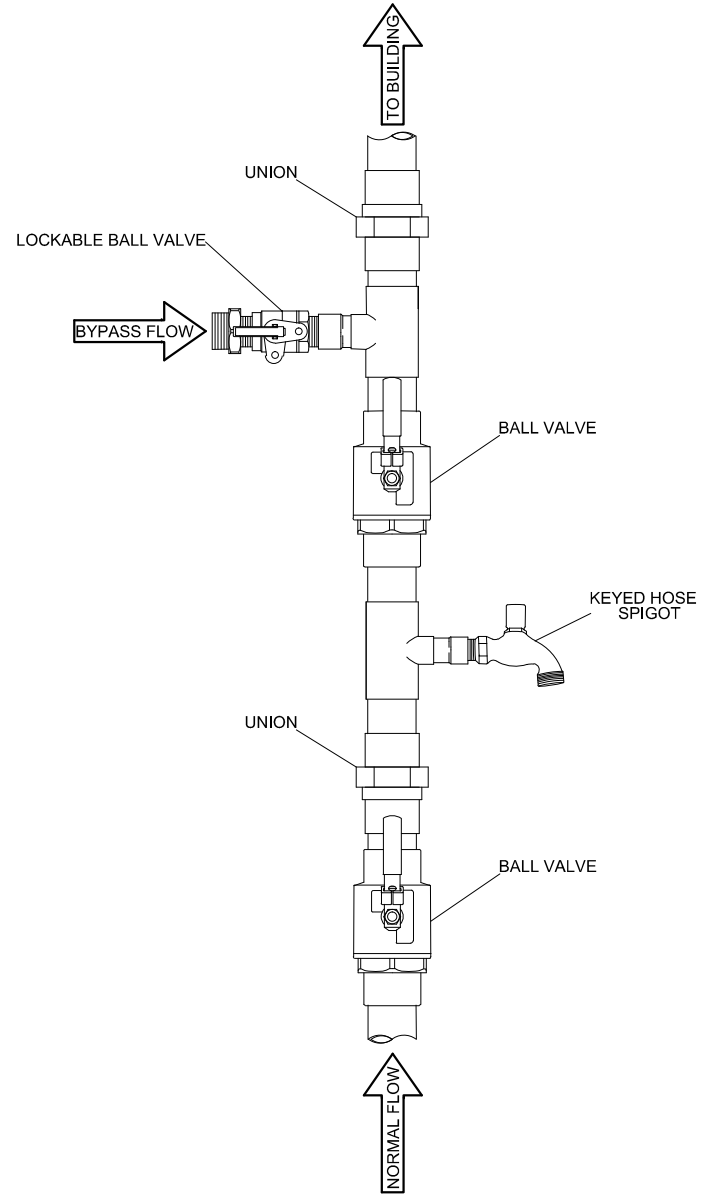

REVISIONS						EASTERN MUNICIPAL WATER DISTRICT	
DATE	BY	MARK	DESCRIPTION	APPR.	DATE		
						BUILDING CROSS CONNECTION BYPASS	A-011
						APPROVED: <u>EXAMPLE</u>	DATE: _____
						DATE PREPARED: 6-8-2017	SCALE: NONE