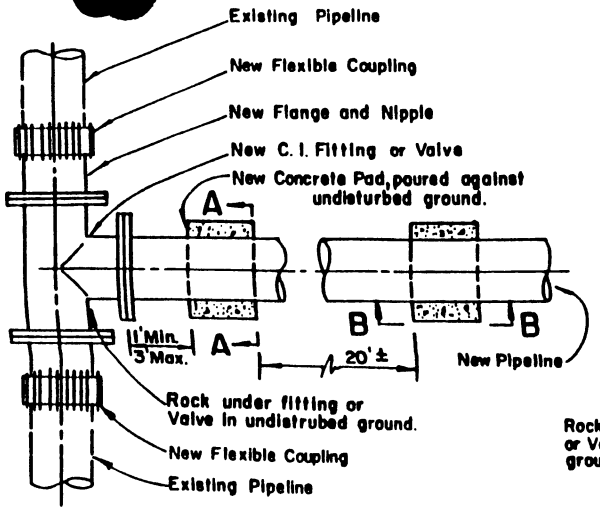

PLAN

CONNECTION TO EXISTING STEEL PIPELINE



SECTION B-B



SECTION A-A

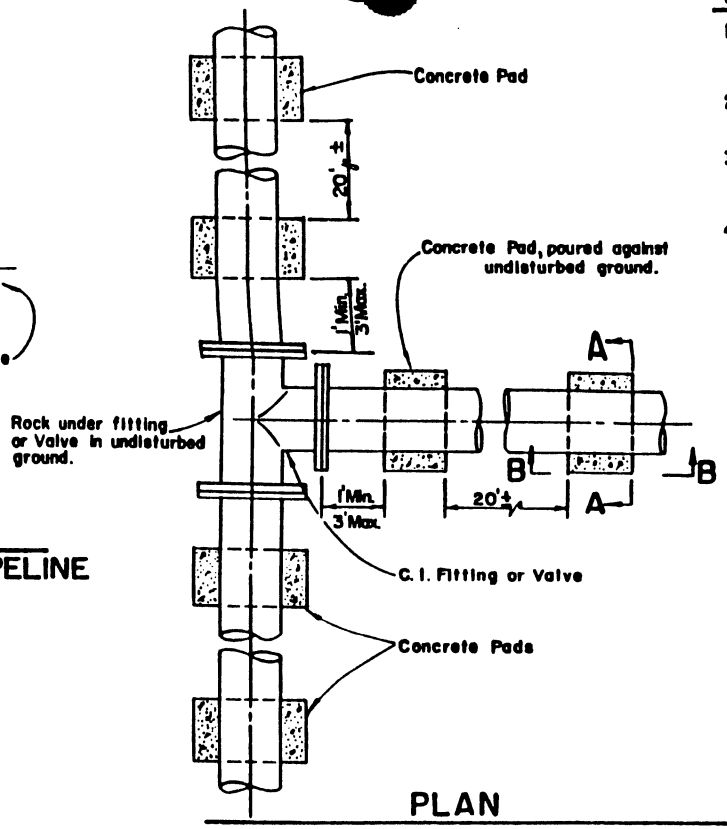

PLAN

NEW STEEL PIPELINE INSTALLATION

NOTES

1. Class "C" concrete pad to be poured against undisturbed trench wall after pipe is installed and flange connection is made to C.I. fitting or valve.
2. Pad shall be poured to avoid interference with connections or special fittings.
3. Valves 12" and smaller shall be supported as shown hereon. Refer to Dwg. B-255 and B-279 for additional supports for valves 14" and larger.
4. Where valves are called out on construction drawings they are to be bolted to C.I. fitting and then proceed with assembly as shown.
5. Locator tape to be (3") three inch wide and placed above the reclaimed water line stating in (2") two inch high lettering, CAUTION RECLAIMED WATER. The color of the tape shall be PURPLE - Pantone 522C. 1 2

REVISIONS					REFERENCES				SCALE NONE	DATE	EASTERN MUNICIPAL WATER DISTRICT RIVERSIDE COUNTY, CALIFORNIA	W.O.
NO	DATE	INITIAL	DESCRIPTION	APP'VD					DESIGNED			C.O.
1	8-14-88	S.K.D.	Revised color.						DRAWN S.K.D.	7/88	STANDARD DRAWING	
2	1-13-95	K.E.R.	Revised color, tape callout						TRACED		RECLAIMED WATER STEEL PIPELINE INSTALLATION	COORD:
3	1-27-95	K.E.R.	REVISED DWG # FROM PB-5 TO PB-5						CHECKED			SHT. 1 OF 1
					APPROVALS				SUBMITTED			
					DESIGN	OPER.	CONST.	R/W	RECOMMENDED 8/23/88		APPROVED W. D. Plummer CHIEF ENGINEER 8/25/88 DATE	PB-5 4 3