

**MATERIALS LIST**


- ① BROOKS 1-RT VALVE BOX MARKED "SEWER", OR APPROVED EQUAL.
- ② THREADED CAP WITH SQUARE NUT.
- ③ MINIMUM 3-1/2" SEWER PIPE PER UNIFORM PLUMBING CODE.
- ④ WYE PER UNIFORM PLUMBING CODE.
- ⑤ MINIMUM 4" LATERAL, OR AS SHOWN ON PLANS, PER EMDW STANDARDS.

**NOTES**

1. PLACE CLEANOUT A MAXIMUM OF 3' BEHIND PROPERTY LINE OR EDGE OF EASEMENT.
2. LID MUST BE CAST IRON FOR LOCATING PURPOSES, MARKED "SEWER"

**ON-SITE CLEANOUT**

N.T.S.

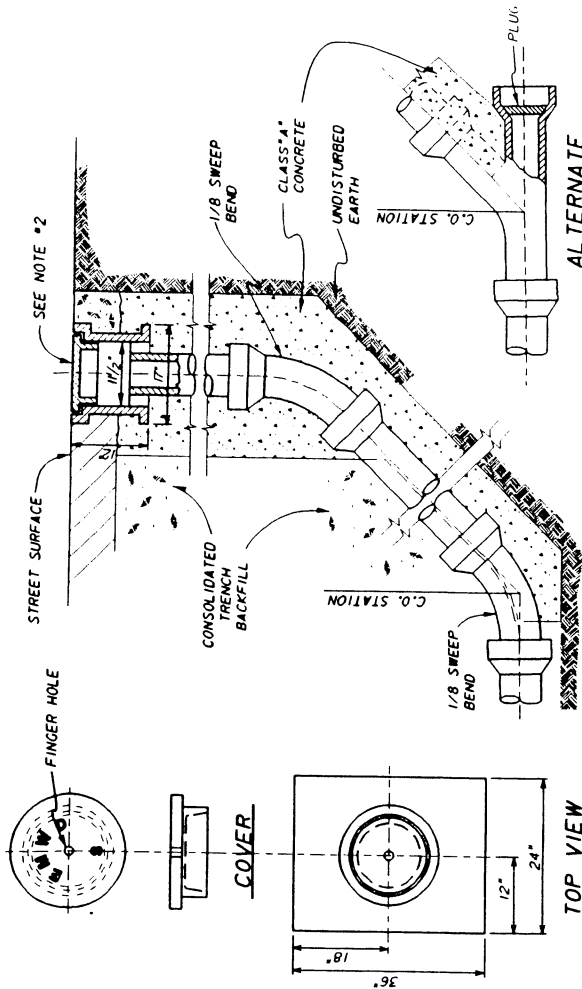

**NOTES**

1. CLEANOUT PIPE MUST BE THE SAME DIAMETER AND MATERIAL AS MAIN LINE SEWER.
2. CASTING SHALL BE ALHAMBRA FOUNDRY NUMBER A-1241 OR APPROVED EQUAL.
3. COVER, FRAME, AND CONCRETE PAD ARE TYPICAL FOR 8" I.D. MAIN LINE SEWERS ONLY.
4. USE CLASS "A" CONCRETE THROUGHOUT.
5. PLUGS SHALL BE CEMENTED IN PLACE WITH CEMENT MORTAR OR SHALL BE NEOPRENE PLUG OR APPROVED EQUAL.
6. STATION OF LOWER 1/8 BEND OR WYE SHALL CORRESPOND TO THE CLEANOUT STATION SHOWN ON THE CONSTRUCTION DRAWINGS WITH CLEANOUT CONSTRUCTION EXTENDED BEYOND THAT POINT AS NECESSARY.

**MAIN LINE CLEANOUT**

N.T.S.



EASTERN MUNICIPAL WATER DISTRICT  
STANDARD DRAWING

**SEWER CLEANOUTS**  
MAIN LINE & ON-SITE

APPROVALS		DATE
INITIAL	DATE	8/63
DESIGN	CONSTRUCTION	
INSPECTION	OPERATIONS	
SUBMITTED		

NO.	DATE	INITIAL	DESCRIPTION
1	2/10/97	KER	REDRAWN W/CADD ON MTLAR

SCALE: NONE  
DRAWN BY K.E.R.

REFERENCES: SUPERCEDES SA-90  
FILE I.D.: /USR/KARL/STNDRS/SB-52

DIRECTOR OF ENGINEERING

APPROVED *Daryl J. Brown* 8/63 DATE  
CHIEF ENGINEER

SB-52