


△ PLAN VIEW  
PLASTIC PIPE

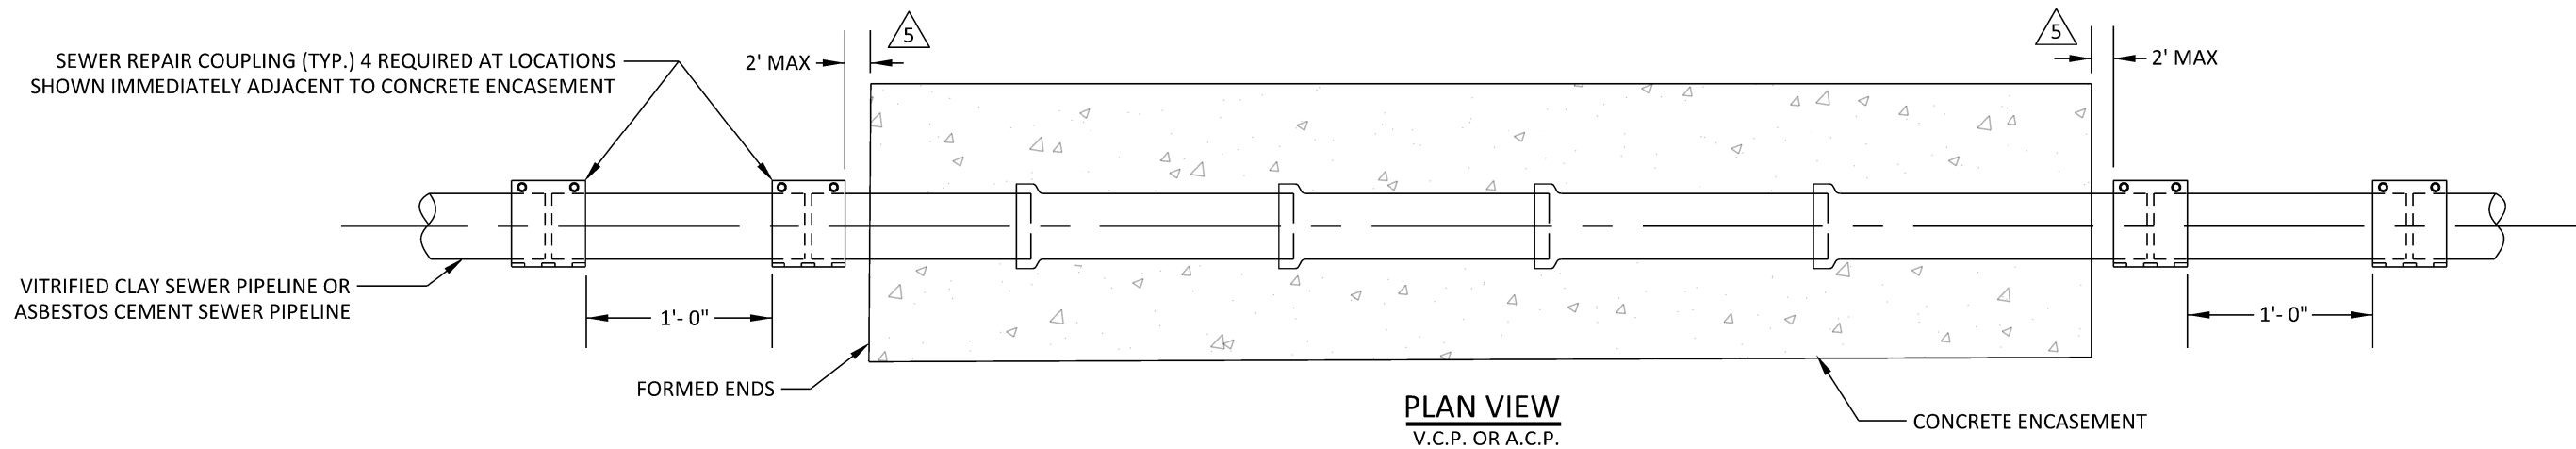

PLAN VIEW  
V.C.P. OR A.C.P.

**NOTES FOR V.C.P. OR A.C.P. :**

1. NO CONNECTION ALLOWABLE AT BELL END OF V.C.P. OR A.C.P.; CUT BELL END OFF PIPE PRIOR TO MAKING CONNECTION.
2. SEWER REPAIR COUPLING SHALL BE REPAIR COUPLING WITH SHEAR RING AS MANUFACTURED BY MISSION CLAY PRODUCTS, OR APPROVED EQUAL, IN CONFORMANCE WITH THE REQUIREMENTS OF A.S.T.M.C. 594 & 5.1.2.3. THE COMPRESSION BANDS AND CLIPS SHALL BE FABRICATED FROM STAINLESS STEEL AISI TYPE 316, AND THE BOLTS & NUTS FROM STAINLESS STEEL AISI TYPE 305, AND THE SHEAR RING FROM STAINLESS STEEL AISI TYPE 304.

REVISIONS						APPROVALS			EASTERN MUNICIPAL WATER DISTRICT STANDARD DRAWING		
NO.	DATE	INITIAL	DESCRIPTION	APP'D	DATE		INITIAL	DATE	SEWER CONNECTION AT CONCRETE ENCASEMENT V.C.P., A.C.P., & PLASTIC GRAVITY SEWER		
6	1/9/23	GS	UPDATED TITLE BLOCK, FONT, LOGO, & REDRAWN IN CADD	ACA	1/9/23	DESIGN	LAM				APPROVED <u>Doyle J. Boen</u> <span style="float: right;">9/10/70</span> CHIEF ENGINEER <span style="float: right;">DATE</span>
5	2/2/93	CFW	REVISED DISTANCE BETWEEN FLEX CPLG. AND CONC. ENCASEMENT	VJB	2/2/93	CONSTRUCTION			SB-63		
4	4/10/79	SBJ	ADDED PLASTIC PIPE	JVB	4/10/79	INSPECTION					
3	2/16/73	MCM	REVISED TO SAY "PLAN VIEW"	LAM	2/16/73	OPERATIONS	CAG				
2	10/27/70	HS	GENERAL REVISION	LAM	10/27/70	SUBMITTED	LAM				
REFERENCES:				SCALE: NONE						6	
FILE I.D.: \kauai\eng\std dwgs\SB-63.dgn				DRAWN BY: GS							

