
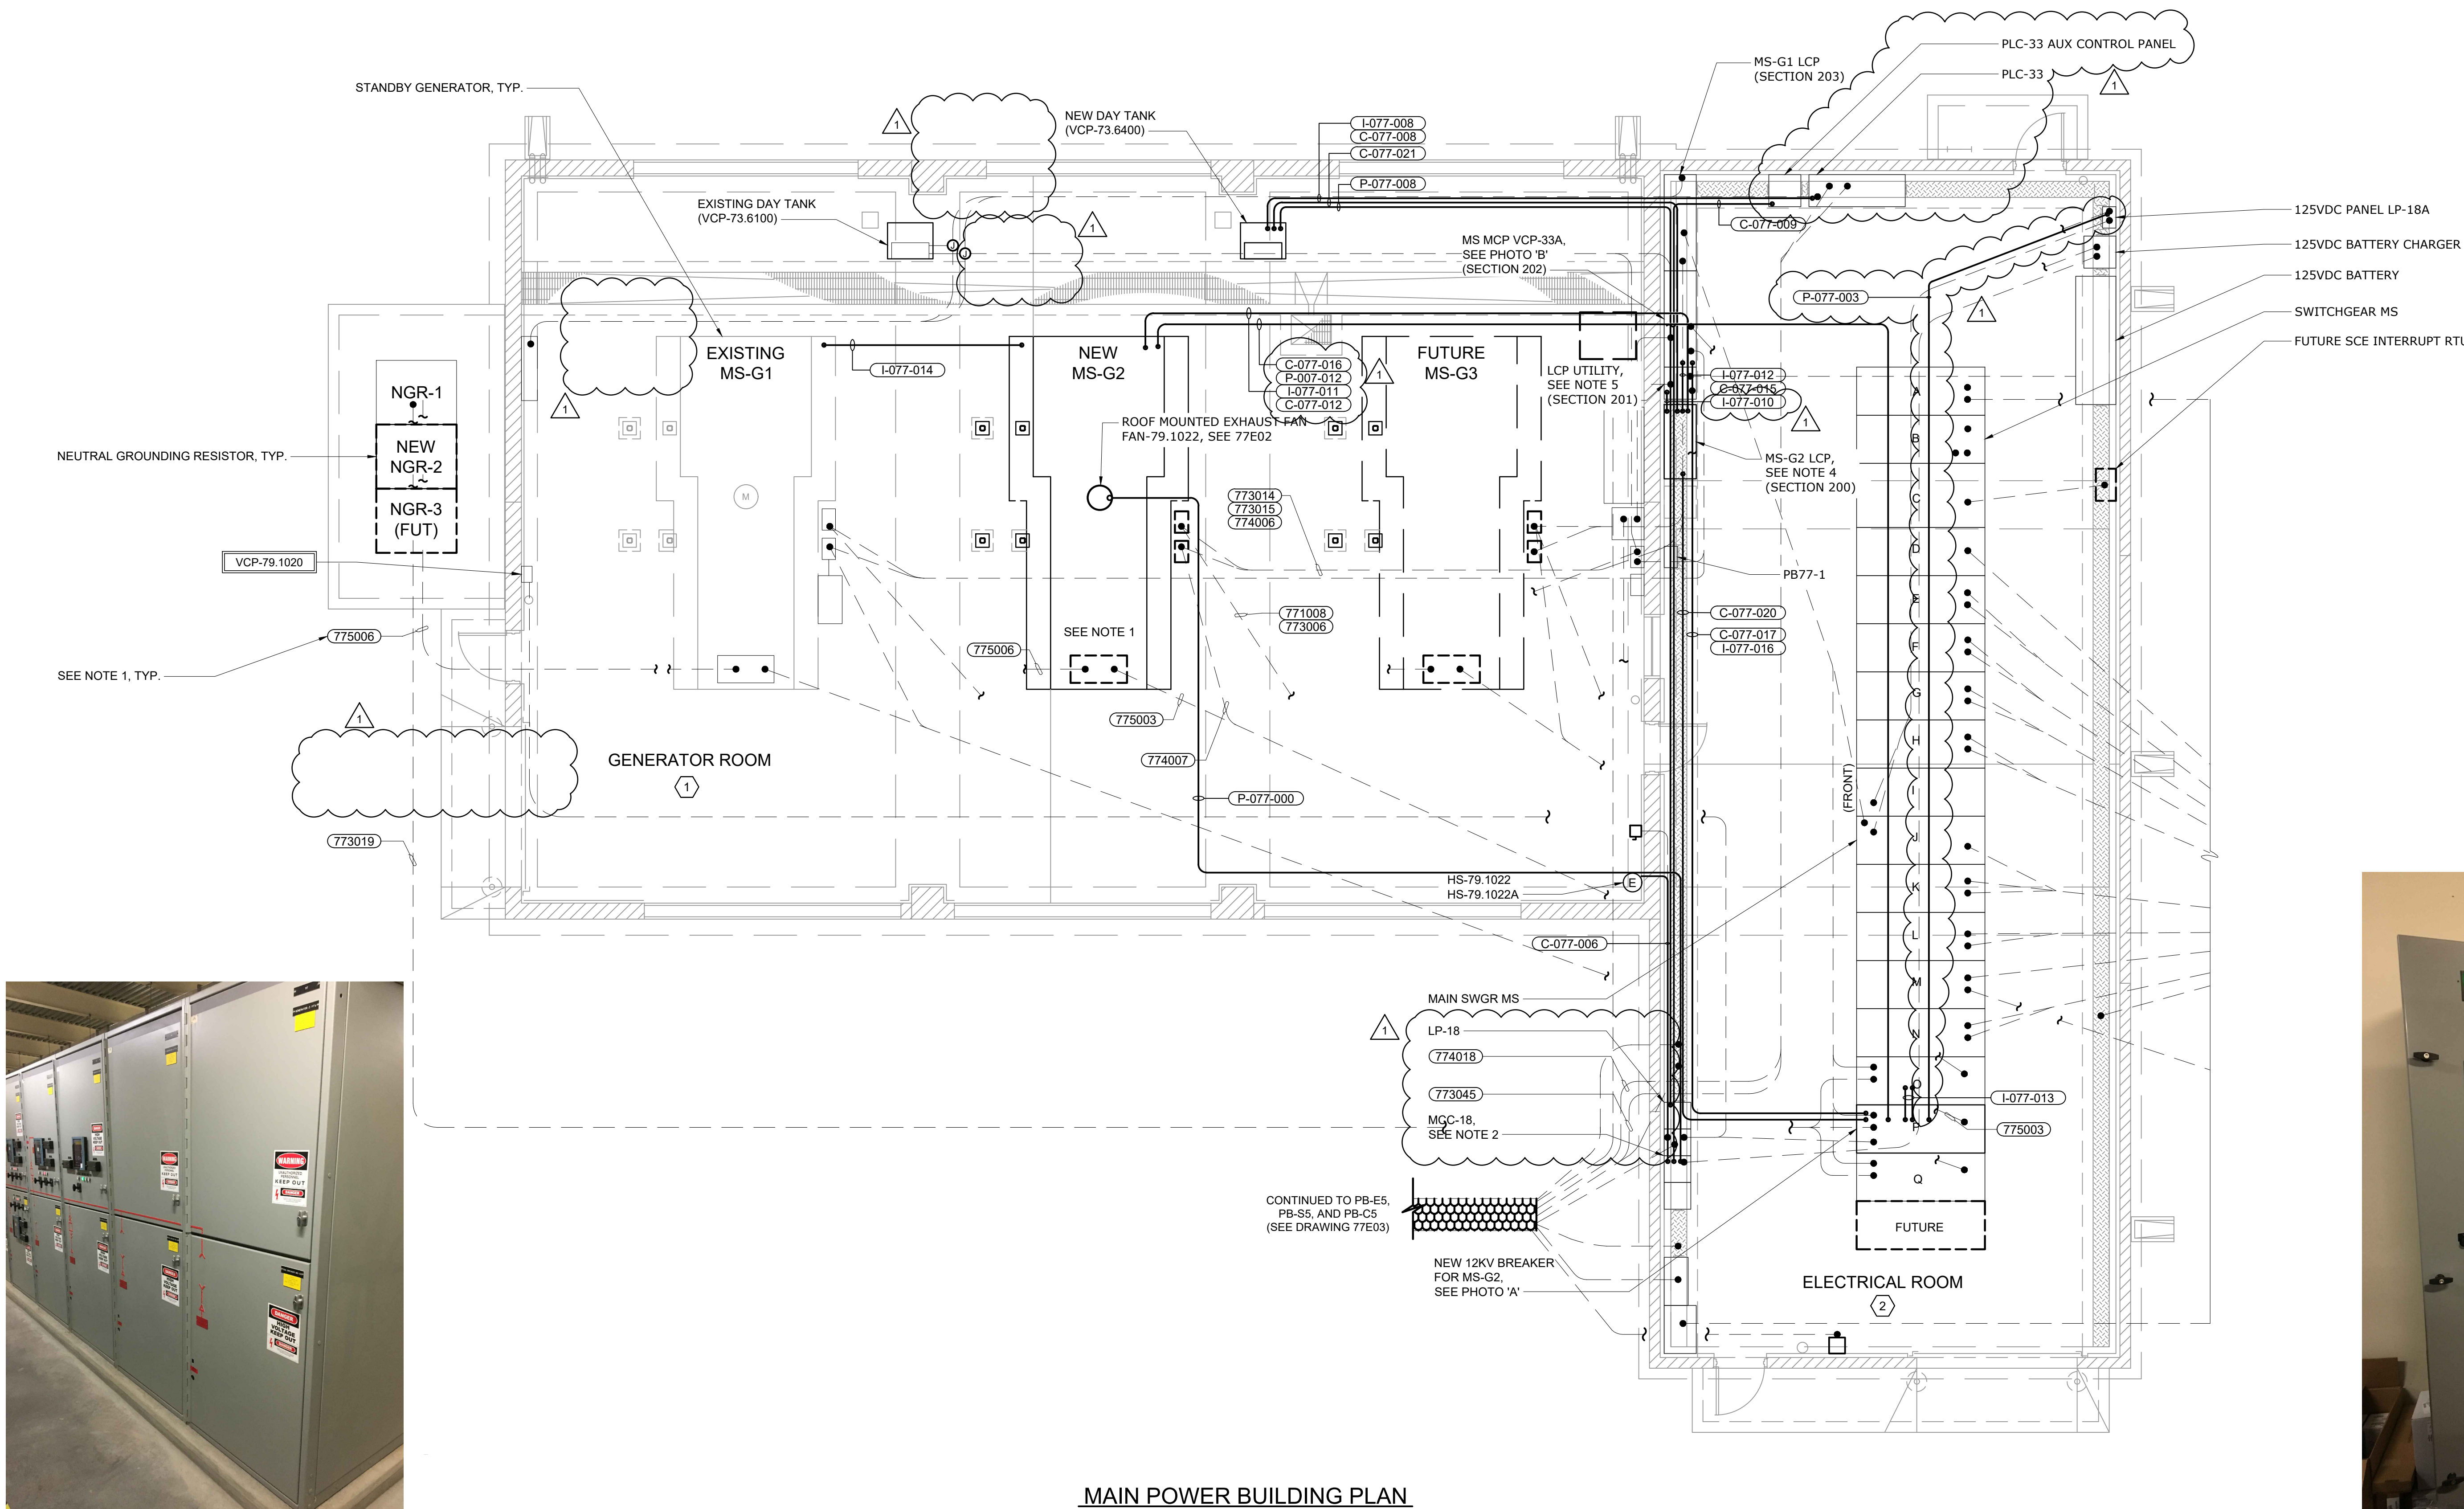


NOTES:

- EXISTING UNDERGROUND CONDUITS ARE IN PLACE FROM A PREVIOUS PROJECT. REFER TO RISER DIAGRAMS ON 77E08 FOR FURTHER INFORMATION.
- UTILIZE A SPARE 20A BREAKER FOR MS-G2 JACKET HEATER.
- FURNISH AND INSTALL ANY CONDUIT AND WIRE REQUIRED AS SURFACE MOUNTED.
- FURNISH AND INSTALL MS-G2 CONTROL PANEL AS SHOWN.
- ALL BREAKER INPUTS AND OUTPUTS SHALL BE TERMINATED WITHIN VCP-33A TO MATCH EXISTING CONTROLS AND MONITORING.
- ALL MATERIALS OF CONSTRUCTION AND ENCLOSURE TYPES SHALL BE PROVIDED IN ACCORDANCE WITH THE AREA DESIGNATION TABLES IN THE APPROPRIATE DIVISION 16 SPECIFICATION SECTIONS.

AREA DESIGNATIONS:

- 1 INDOOR DRY PROCESS AREA
- 2 INDOOR DRY NON-PROCESS AREA



MAIN POWER BUILDING PLAN
3/16" = 1'-0"



'P' & 'Q' OF MAIN SWGR-MS
NTS



VCP-33A
NTS

SPEC NO. 1360S

CALL BEFORE YOU DIG!
UNDERGROUND SERVICE ALERT
CALL: TOLL FREE
1-800-227-2600
TWO WORKING DAYS BEFORE YOU DIG



REVISIONS					
No.	DATE	INITIAL	DESCRIPTION	APP'D	DATE
1	3/25/19	CNT	ADDENDUM NO. 3		

APPROVED BY:
MARC SERNA, P.E.
DIRECTOR OF ENGINEERING

EASTERN MUNICIPAL WATER DISTRICT
ERIK JORGENSEN, P.E.
PROJECT MANAGER

DATE
DESIGNED G. FRON
DRAWN A. STARLIN
TRACED
CHECKED C. THUNHORST
SUBMITTED



EASTERN MUNICIPAL WATER DISTRICT
RIVERSIDE COUNTY, CALIFORNIA
SAN JACINTO VALLEY REGIONAL WATER RECLAMATION FACILITY
BLOWER ELECTRIFICATION PROJECT
ELECTRICAL MAIN POWER BUILDING PLAN

LD. 17
S.A. 79100
W.O. 419003
C.O.
COORD. 46C56
SET. 72 OF 107
D-57428
77E01

Path: 01\2007-1-5F01\2007-005\CAD_BIM\22-SJRWRF-Electrical File: 77E01.dwg Plot Date: March 24, 2019 - 1:26 PM CADD User: Panez, Victor