

# WATER MAIN DROP GUIDELINES


PROJECT NAME:

WO/CO ACCT NO:	DRAFTED BY: GS
REVISION DATE: 11/20/2019	REVIEWED BY: ARMANDO ARROYO



**CASE III:**

1. ALL WATER MAIN CROSSINGS EXTENDING LESS THAN A HUNDRED FEET (100 FT) FROM CENTER LINE TO CENTER LINE OF PIPELINE(S) OR STRUCTURE(S) SHALL REMAIN UNDERNEATH PIPELINE(S) OR STRUCTURE(S), UNLESS OTHERWISE APPROVED BY EMWD.
2. ALL PVC JOINTS MUST BE RESTRAINED WITH EBAA IRON 2000 SERIES OR APPROVED EQUAL.
3. ALL CML&C JOINTS MUST BE FULL WELD DOUBLE PASS.

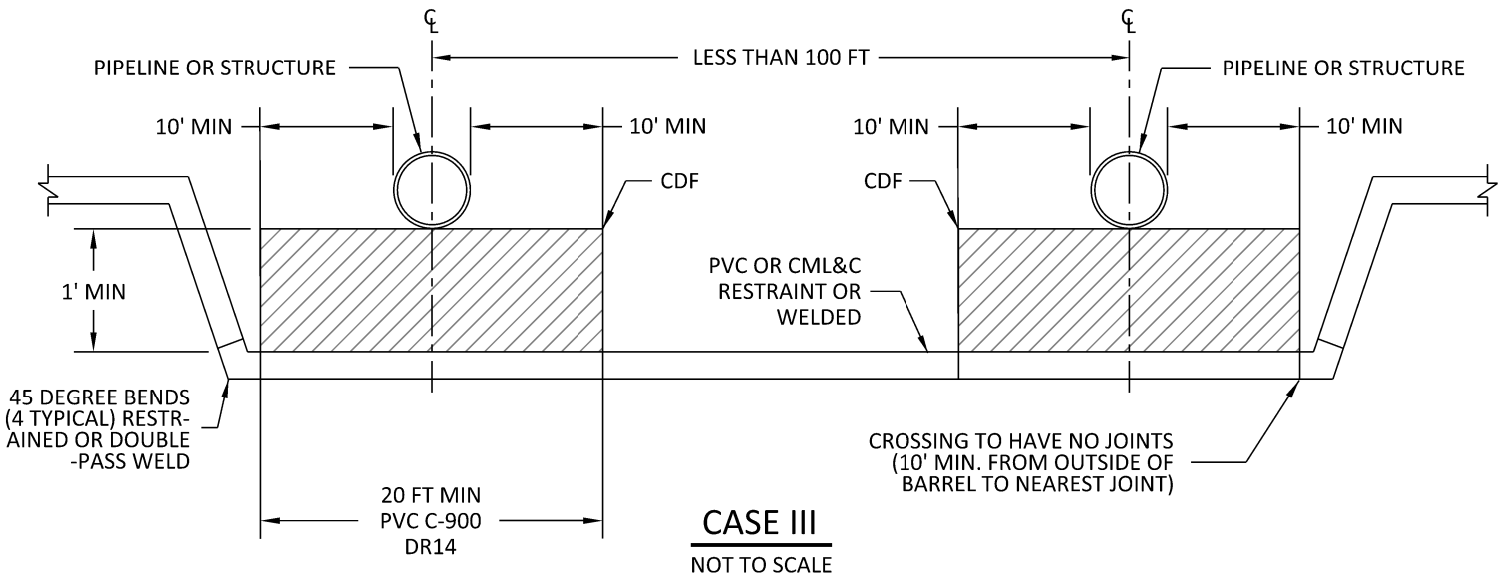

**CASE IV:**

1. PVC C-900 DR14 12" AND SMALLER MAY BE USED FOR MULTIPLE CROSSINGS AS LONG AS IT MEETS THE 10 FOOT MINIMUM CLEARANCE PER GENERAL NOTE NO. 2, UNLESS OTHERWISE APPROVED BY EMWD.

